

Q/GDW

1
2
3
4
5
6
7
8
9

A
B
C
D
E

1
1
1
1
3
4
7
8
8
9
11
13
19
28
32

“

”



A.1

A.2

A.3

A.4

A

B.1

B.2

B.3

B.4

C.1

					m ²
1				(0~20000)N, ≥ 5kHz, 2.5 5 ₀ ^{+0.01} kg 48mm 45#	≥ 15
				45# , 3 ₀ ^{+0.05} kg, : 60 ° , 0.5mm, 40mm, 28mm, HRC45	
2				20kN, ≥ 800mm 1.0	≥ 15
3				20kN, ≥ 800mm 1.0	
4				20kN, ≥ 800mm 1.0	
5				\	\

					m ²
6				20kN ≥ 800mm 1.0	≥ 15
7				20kN ≥ 800mm 1.0	
8				≥ 50mΩ 1 ≥ 30A	≥ 15

C.2

					m ²
1	35kV			DL/T 740	≥ 50
				≤ 50kV 1	
			1		
				150kV 1	
2	66kV~220kV			DL/T 740	≥ 100 10m
				150kV 1	
			1		
				500kV 1	



									m ²
						DL/T 740			
3	330kV	1			500kV	1		≥ 300	20m
						1500kV	1		
						DL/T 971			
4		1			50kV	1			
		1			100kV	1			
5	35kV				≥ 50mΩ	1		≥ 30A	
		1			100kV	1			
					≥ 50mΩ	1		≥ 30A	
6	66kV~220kV								

					m ²
8	() 35kV		1		
				150kV 1	
9	() 66kV~220kV		1		
				500kV 1	
10	() 330kV		1		
				1500kV 1	
				1000kV 1	
11				0.5m	≥ 50
				150kV 1	
12				50kV 1	≥ 30
				DL/T 1476	
13				100kV 1	

C.3

					m ²
1				50kV 1	≥ 30
			1		
				50kV 1	
				30mA 1	
2				50kV 1	
			1		
				50kV 1	
				30mA 1	
			1		
3				50kV 1	≥ 30
				DL/T1476	


C.4


					m ²
1				5kN, 1 , AC220V	≥ 15
2				5kN, 1 , AC220V	
3				5kN, 1 , AC220V	
4				300kN/20kN 15m , 1.2m 1.0	
5				5kN, 1 , AC220V	
				(5Kg/10kg, 3%, 300kg)	
6				5kN, 1 , AC220V	
				(5Kg/10kg, 3%, 300kg)	
				1T	


D.1


D.2- D.7


D.1

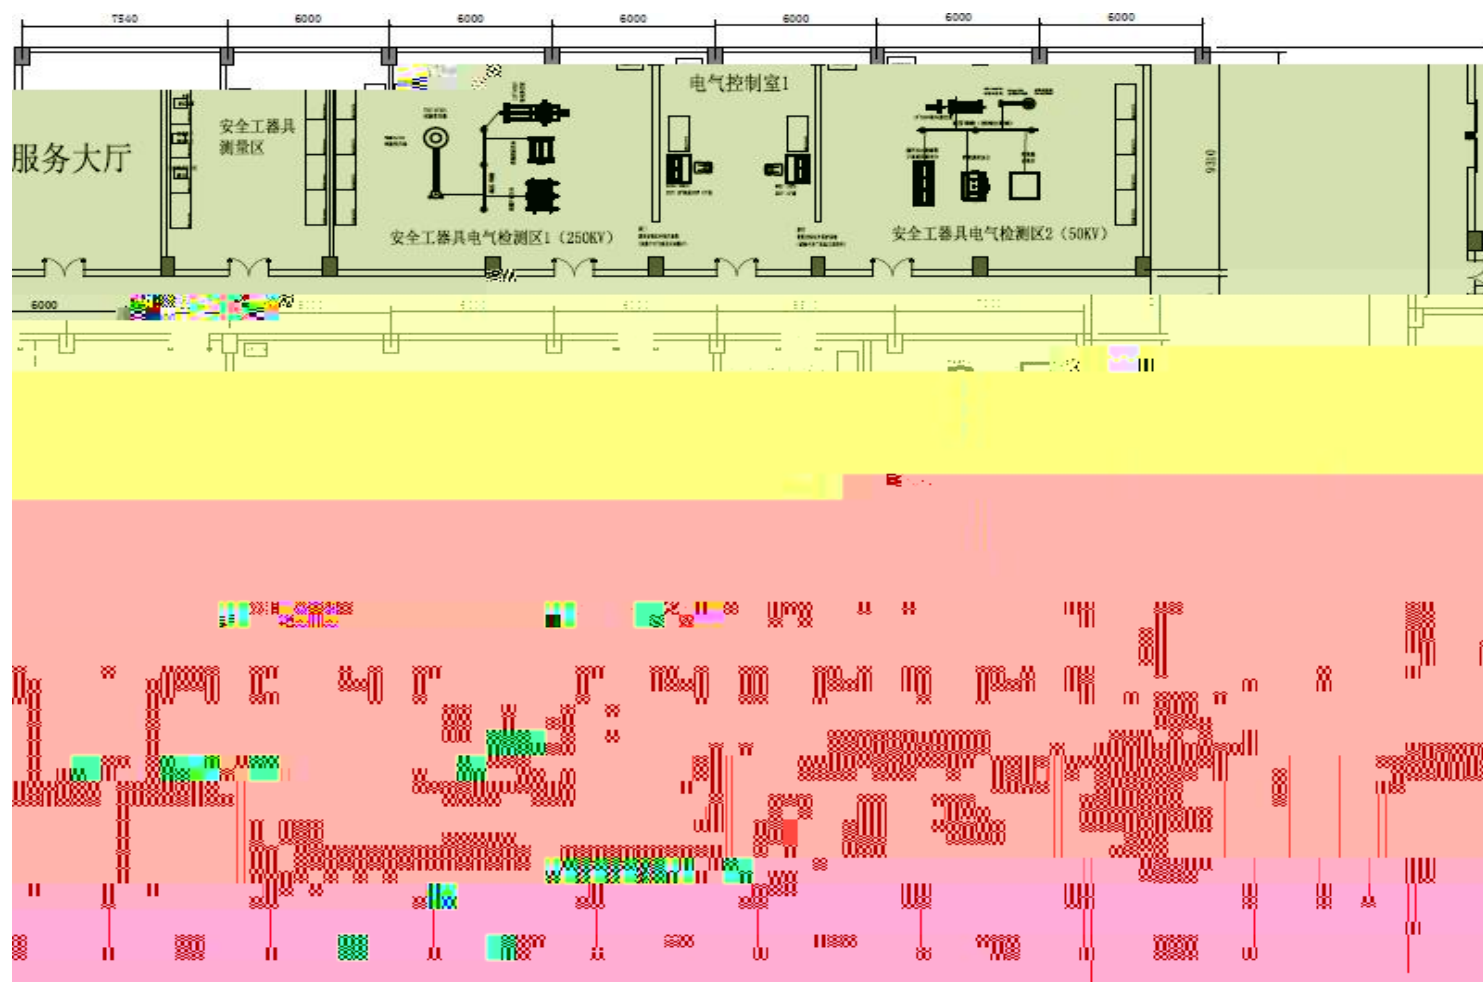


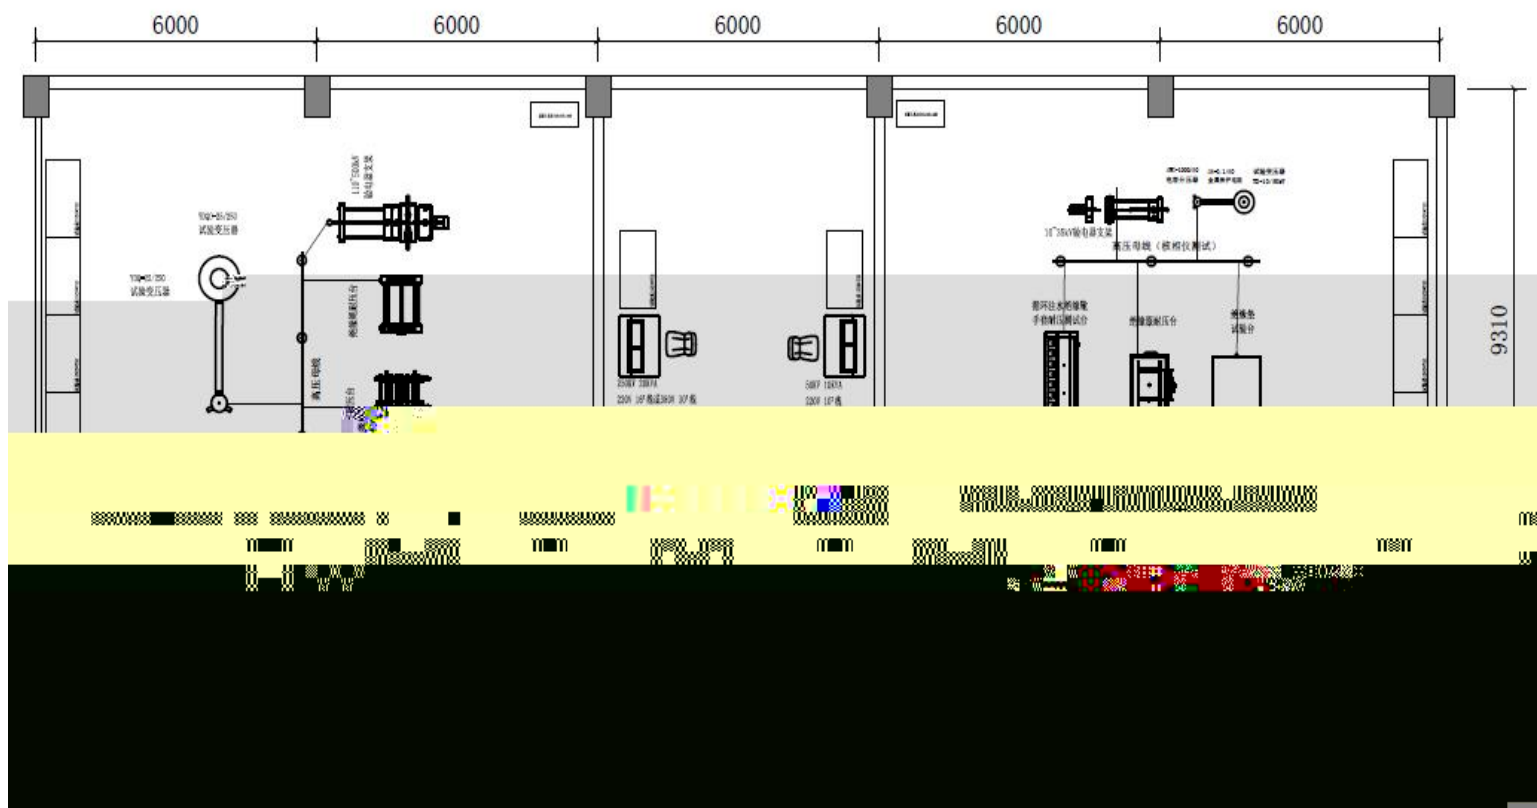


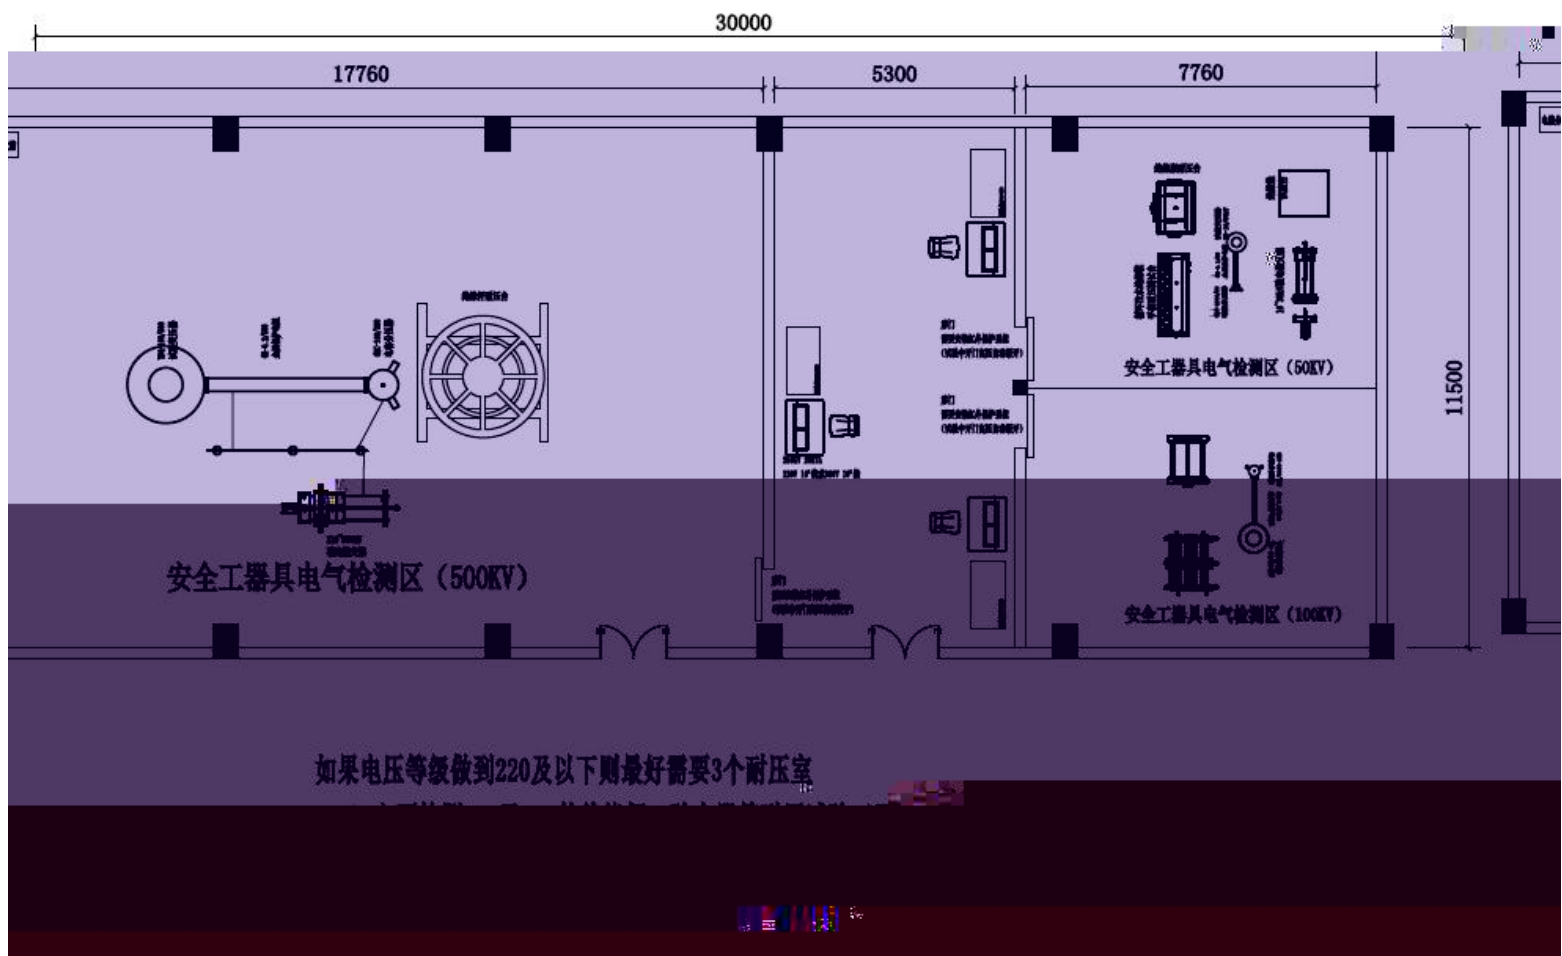

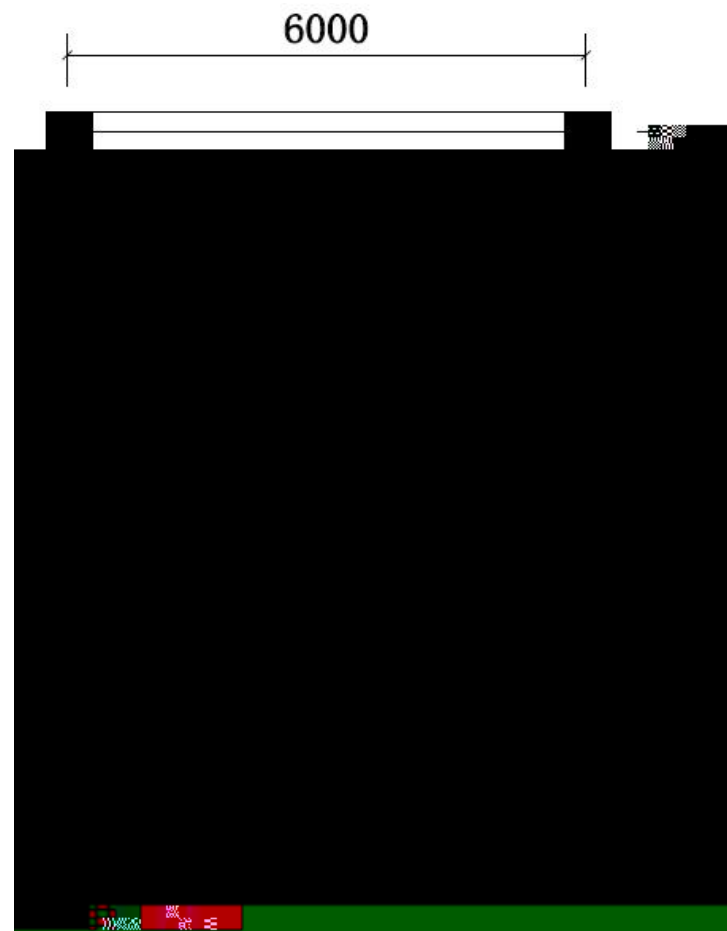

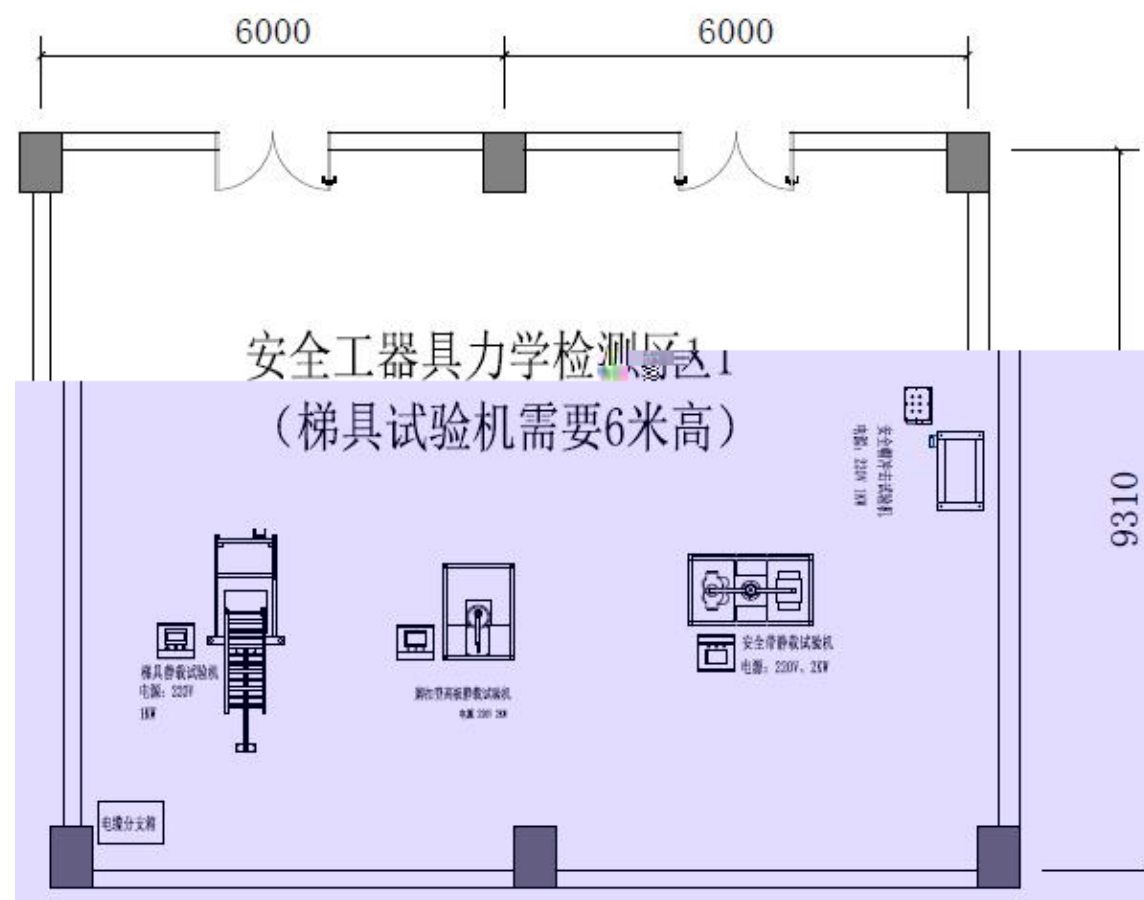

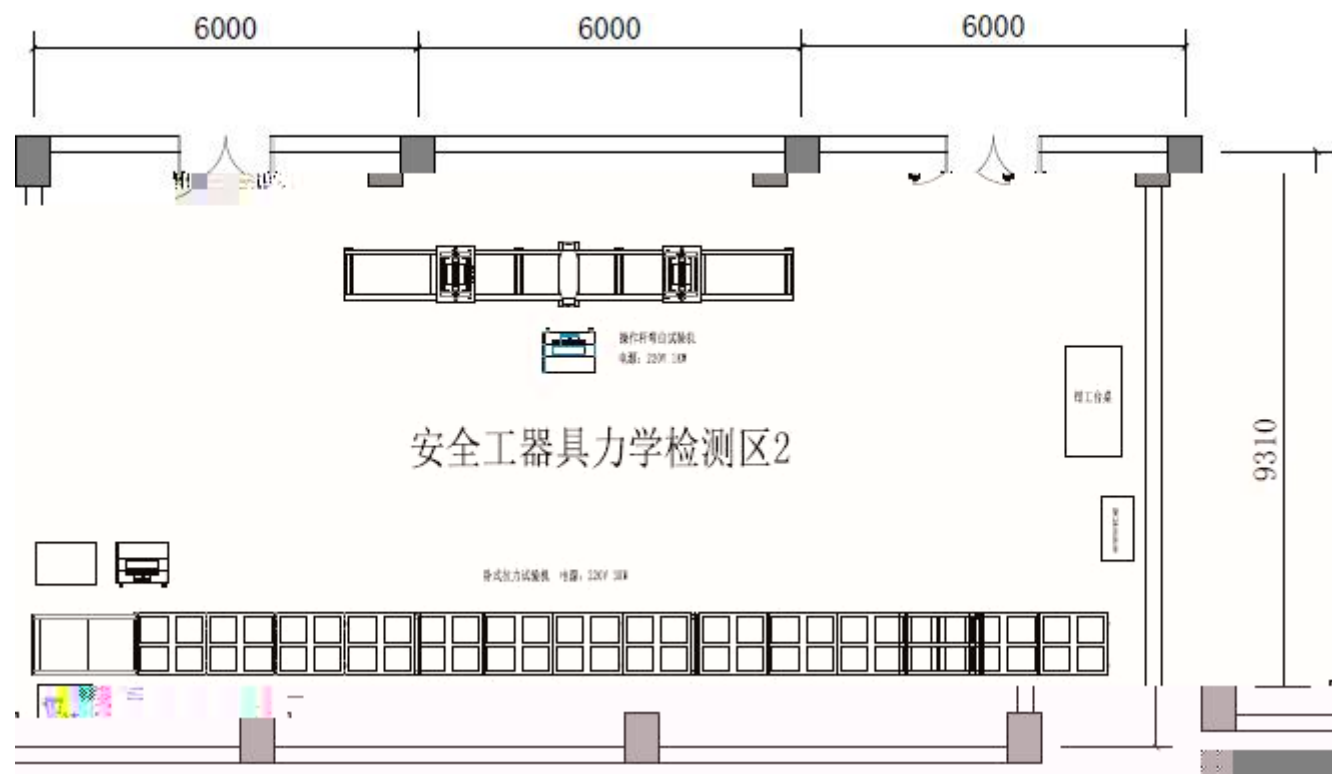

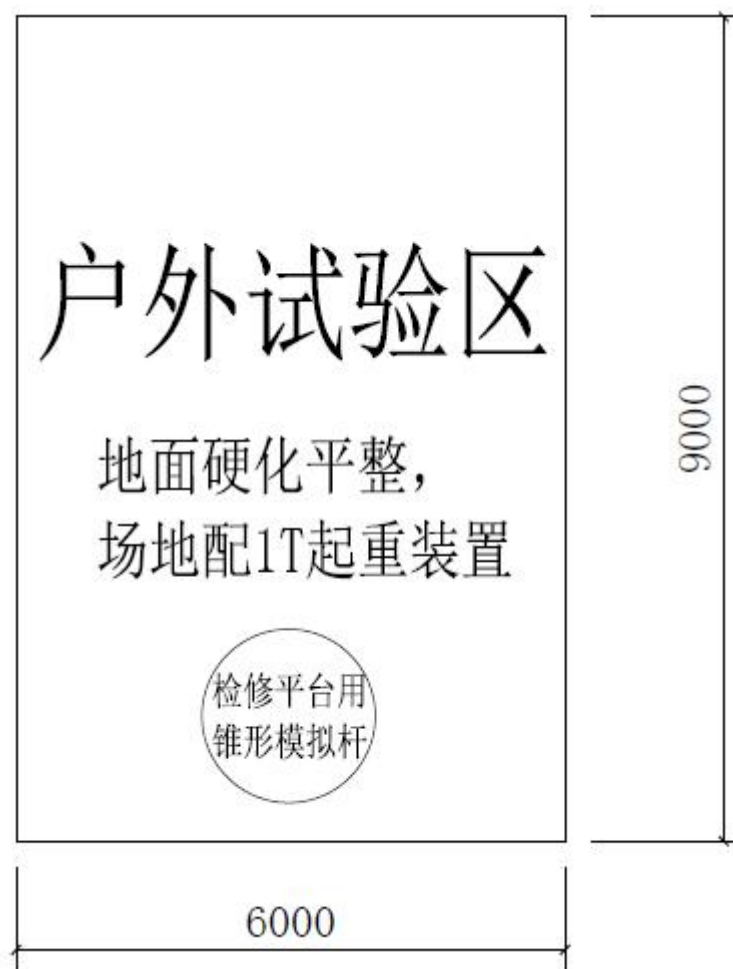

检测机构名称	
合格证	
样品编号	

E.2-E.4

检测报告

委托单位：

样品名称：绝缘杆

型号规格：220kV

检测类别：性能试验（预防性试验）

×××检测中心

检测结果

序号	检测项目	标准要求	检测结果	评价
1	绝缘杆 工频耐压试验	试验长度：2.1m； 试验时间：1min； 试验电压：440kV _{CE}		

报告正文

绝缘*

1	34
2	34
3	34
4	34
5	34
6	35

“ ”